

Paper presented at the 34th International Electric Vehicle
Symposium and Exhibition (EVS34)
Nanjing, Jiangsu, June 25-28, 2021

Pre-Print

Challenges in grid integration of electric vehicles in urban and rural areas

Jakob Gemassmer¹, Carolin Daam¹, Ricardo Reibsch²

¹Reiner Lemoine Institut gGmbH, Rudower Chaussee 12, 12489 Berlin, jakob.gemassmer@rl-institut.de

²RLS-Graduate School, EnergieSystemWende, Reiner Lemoine Institut

Summary

The ramp-up of battery electric vehicles (BEVs) could lead to severe grid issues but also enables flexibility. This paper provides a better understanding of the challenges and potentials of integrating BEVs in power grids. Three charging strategies were modelled on four use cases and six low-voltage grids for urban and rural areas. Especially in rural areas, where many cars charge at home overnight, the charging strategy significantly affects grid issues. Purely market-oriented strategies can lead to high load peaks and thus to transformer and line overloading, while even a relatively simple, balanced charging strategy can significantly reduce grid issues.

Keywords: BEV, smart charging, passenger car, power, energy network

Introduction

The share of renewable energies in electricity generation is steadily increasing, exceeding 50 % in 2020 for the first time in Germany [1]. At the same time, the share of battery electric vehicles (BEVs) is also increasing. Last year, the share of new electric passenger cars registrations in Germany tripled. Currently, over one per cent of all registered passenger cars are electric [2]. This share will grow strongly in the coming years. According to own calculations based on [3], around 40 million vehicles in Germany will be electrified in 2040, corresponding to around 85 % of all passenger cars. In the wake of these changes, flexibility options are becoming increasingly important for grid operators. Battery electric vehicles offer a high potential for this flexibility demand due to the built-in storage and the possibility to charge flexibly during the entire standing time.

However, this potential varies depending on the charging option and region. For this purpose, the German Federal Ministry of Transport has defined seven charging use cases (see Figure 2). Because of the different mobility and parking behaviour in urban and rural areas, the charging demand and, therefore, the distribution among the seven charging use cases also differs. Together with different charging strategies, this distribution can result in different impacts on the power grid.

Because power grids are usually designed for several decades, the impacts and potentials of electric vehicle integration need to be included in long-term planning. Therefore, the primary research questions of this paper are:

1. How does charging demand differ in urban and rural areas?
2. What impact do different charging strategies have on the load profile of electric vehicles at different charging use cases?
3. What is the impact of integrating electric vehicles on the power grid in urban and rural areas?

These questions are investigated based on the German states of urban Berlin and rural Brandenburg, which differ in mobility behaviour and grid topology. This paper will compare the impact of three different charging strategies on low-voltage grids for the two types of region.

1 Methodology

1.1 Number of electric vehicles

In line with current developments, the share of electric cars will rise sharply in the coming years. The increase in electric vehicles can vary from region to region. Currently, electric cars are more often registered in urban areas than in rural areas. Areas such as Berlin, which have been well above the national average electrification rate, are therefore expected to achieve full electrification a few years earlier than rural regions such as Brandenburg. The calculations for Figure 1 are based on studies by RLI and [3].

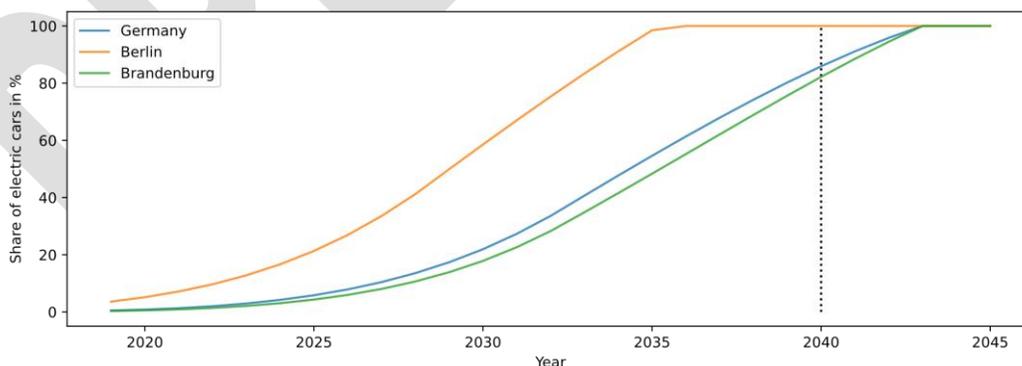


Figure 1: Ramp-up of electromobility in Germany, Berlin and Brandenburg

Assuming a constant level of motorisation (number of cars per inhabitant), in 2040, around 1.12 million cars will be registered in Berlin and 1.38 million cars in Brandenburg. Different development rates are applied to determine the number of electric passenger cars following the different electrification development in the urban and the rural federal state. By 2040, in Berlin, all registered passenger cars are expected to be electric, while in Brandenburg, this share amounts to around 82 %.

The registered passenger cars are distributed very differently among the households. While in Berlin, only 49 % of the households own a car, the figure is 79 % in rural Brandenburg. The number of cars per household also differs. All characteristic values are listed in Table 1.

Table 1: Comparison of the electric passenger car development of Berlin and Brandenburg in 2040 [4, 5, 6]

	BERLIN			BRANDENBURG		
POPULATION	3,919,000			2,418,000		
DEGREE OF MOTORISATION	287 Cars per 1.000 Inhabitants			572 Cars per 1.000 Inhabitants		
NUMBER OF VEHICLES	1,124,000			1,383,000		
ELECTRIFICATION RATE	100 %			82.2 %		
NUMBER OF BEVS	1,124,000			1,137,000		
VEHICLES PER HOUSEHOLD	0.6			1.1		
SHARE OF HOUSEHOLDS WITH 0 / 1 / 2 / 3+ VEHICLES	51 % / 43 % / 6 % / 0 %			21 % / 54 % / 22 % / 2 %		
VEHICLE CLASSES	Small	Medium	Large	Small	Medium	Large
	39 %	46 %	14 %	39 %	49 %	12 %
CAR OWNERS WITH PRIVATE PARKING SPACE	37 %			83 %		

1.2 Driving profiles

In a first step, driving profiles for the vehicles in both regions are created. In Germany, mobility behaviour is regularly investigated by the study “Mobility in Germany” (MiD – Mobilität in Deutschland). The survey asks around 150,000 households about their mobility behaviour, including aspects like daily trips, the trip purpose, the time and distance travelled and the mode of transportation. The last survey dates back to 2017, with over 900,000 individual trips recorded [4].

At the Reiner Lemoine Institut, the tool SimBEV was developed to create driving profiles for passenger cars for seven different region types. The basis for the driving profiles is probability data gained from the analysis of MiD2017. The different region types are based on the RegioStaR7-classification given by the German Federal Ministry of Transport and Digital Infrastructure (BMVI) [7]. The created driving profiles include information like the status of the car for every 15 minute time step, location of the car and the energy used during a trip. Additionally, by providing probabilities of how likely it is to charge at a specific location, the output includes information on whether a charging point exists at that location and the maximum charging capacity. Possible locations for parked cars are work, business (business trips starting from work), school, shopping, private/ridesharing, leisure and home. Probabilities are based on [4, 8, 9].

Mobility behaviour in rural and urban areas differs mainly in the distances travelled daily and the parking possibilities. As a large city, distances travelled daily in Berlin are relatively low, and people who own a

private car seldom have a private parking space available. As a predominantly rural state, Brandenburg distances are higher but fewer trips per week are made, and most people have access to an own parking space. The two study areas Berlin and Brandenburg also differ in their degree of motorisation and the parking possibilities. In Berlin, the degree of motorisation is 28.7 %, and around 37 % of people have access to a private parking space. In Brandenburg, the degree of motorisation is almost twice as high, with 57.2 %, and the majority of people has access to an own parking space (83 %) (Table 1).

If a trip is longer than the remaining battery capacity, a fast-charging event is triggered. At a fast-charging hub, the maximum charging capacity of the charging point is defined as either 150 or 350 kW. Additionally, the destinations from the study MiD2017 are assigned to four different charging use cases, according to Figure 2: Home, Work, Charging hub and Public.

Installation location	Private space			Publicly accessible space			
Charging use case	Home		Work	Charging hub		Public	
Typical locations for charging infrastructure							
	Garage or private parking space at home	Parking spaces (e.g. in residential areas, multi-family houses, apartment blocks)	Company parking on own site	Charging station/charging hub in town	Charging station/charging hub on road axes	Customer parking spaces or multi-storey car parks (e.g. shopping malls)	Road side, public parking spaces
Typical charging capacity (kW)	Up to 11	Up to 11	Up to 22	Up to 150	Up to 350	Up to 50	Up to 22
Average standing time	Overnight	Overnight	7 hours	10 - 20 minutes	15 - 30 minutes	30 - 90 minutes	15 minutes up to 14 hours
Destination	Home		Work	Fast charging event		Business, School, Shopping, Private/Ridesharing, Leisure	

Figure 2: Characteristics of different charging use cases

Table 2 shows the usable battery capacity, the consumption, and the maximum charging power for three different vehicle classes' small, medium and large. The battery and maximum charging capacity assumptions are taken from the scenario "Increased Electrification" for 2035-2042 from [10]. Energy consumptions are taken from [11], assuming a 10 per cent decrease until 2040 due to increases in energy efficiency.

Table 2: Characteristics of different vehicle classes in 2040 [10, 11]

	BATTERY CAPACITY	CONSUMPTION	MAX. CHARGING CAPACITY
BEV SMALL	70 kWh	0.126 kWh/km	120 kW
BEV MEDIUM	100 kWh	0.148 kWh/km	350 kW
BEV LARGE	120 kWh	0.171 kWh/km	350 kW

Depending on the region under investigation, a representative sample of 0.1 % of the required number of driving profiles is created for 14 days. For urban Berlin, this adds up to 1,124 driving profiles (441 small, 519 medium and 164 large vehicles), and for rural Brandenburg, 1,137 driving profiles (442 small, 555 medium and 140 large vehicles) are generated. The resulting charging profiles created by applying the charging strategies are then scaled up to the entire vehicle fleet.

1.3 Charging strategies

EVs typically do not need to be charged with maximum power over the entire standing time. Thus, the charging power can be varied within the standing time, allowing for a lower charging power or the load to be shifted according to external signals. The effects on the power grid, therefore, depend heavily on the respective charging strategy. This paper uses the tool SpiceEV (Simulation program for individual charging events of electric vehicles) to apply three different charging strategies on the created driving profiles for urban and rural areas, to investigate the impact on use cases and the power grid.

SpiceEV calculates the actual and the desired State of Charge (SoC) for each charging event. The initial SoC is taken from SimBEV-output. The desired SoC is either defined by the following trip distance or by setting a minimum required value. Independent from the charging strategy, the specific load is distributed within the standing time until the desired SoC of 80 % is reached or the standing time is over. Three charging strategies are applied for this purpose:

Greedy: Charging is performed immediately after plugging in the vehicle at maximum power.

Balanced: Depending on the standing time, the minimum possible charging power is calculated in each time step. As long as this charging power is below 10 % of the charging point's maximum charging power, charging does not occur. As soon as the calculated charging power exceeds the threshold value of 10 %, charging occurs until the end of the standing time.

Market-oriented: This strategy uses the stock exchange electricity price as an external price signal [12]. For the respective charging event, it is determined at which time it is most favourable to charge. In the case of negative prices, additional charging is performed beyond the desired SoC.

Figure 3 shows the charging profile for one medium BEV for the three charging strategies at the use case "work" on March 18. At 07:15, the car is plugged in at the workplace, standing until 16:30. The stock exchange electricity price is lowest at 14:00 with 61.15 €/MWh. The charged energy within one charging event can differ between the strategies since the start SoC depends on previous charging events.

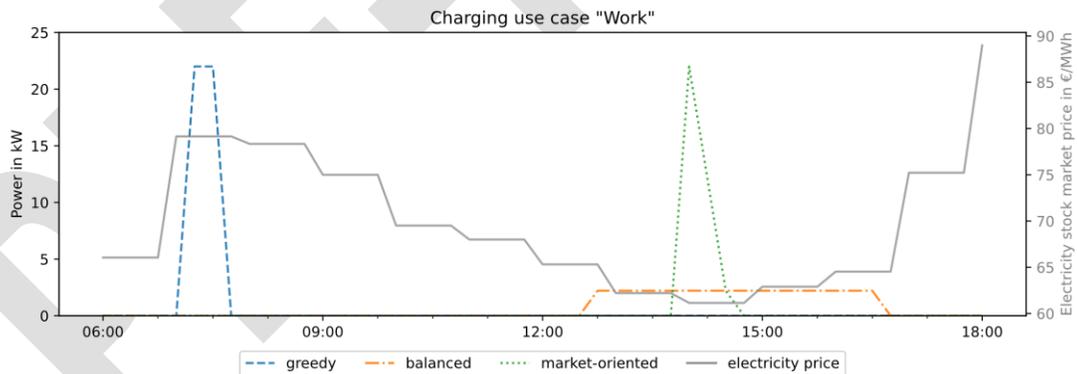


Figure 3: Different charging strategies for one passenger car at work

1.4 Impact on the low-voltage grid

EVs are primarily connected at the low-voltage grid level. Six representative synthetic low-voltage grids for rural and urban regions are examined to assess the impact of different charging strategies on grid stability [13]. While the three rural grids are typically characterized by long line distances, the other three suburban and urban grids, in contrast, are dominated by a higher number of grid consumption points in

a smaller grid area. In this study, suburban and urban grids are defined as urban grids. Thus, the following assumptions made for urban grids are also applied to the two suburban grids in [13].

The low-voltage grids examined are radial networks. This grid topology is the most frequently encountered grid type at the low-voltage level due to its cost structure [14]. Radial grids are characterized by feeders to which consumers are connected and radiate from the local grid transformer. In radial grids, no rings or meshed structures exist.

At times of high consumption, when BEVs charge simultaneously with high charging power, grid issues may emerge [15]. In these cases, high consumption can cause three kinds of grid issues:

1. Voltage issues: They occur mainly at the end of a feeder with long line lengths. The nominal voltage is 1.0 p.u. It should not fall below 0.9 p.u. and not exceed 1.1 p.u. at any bus within the grid [18].
2. Line overloads: They occur mainly in feeders near the transformer.
3. Transformer overloads.

To examine which grid issue emerges at which time and to which extent, power flow calculations are conducted. An own developed model based on the open energy network calculation program pandapower is used [16]. The simulation is based on a 15 minute time resolution and 14 days time scope, defined by the period of the created driving profiles. Only general household loads are considered within the grids based on real measured power consumption profiles [17]. To better understand the impact of BEVs on grid stability, other sector-coupled consumers or grid components, such as heat pumps, decentralized energy production units or stationary energy storage units, are not considered. Additional consumption or production units may superimpose the effects on the grid stability and probably lead to indistinct conclusions. Nevertheless, the interaction of different sector-coupled consumers, decentralized energy production units, and storage units appears worth investigating for future energy system planning but is not part of this study.

According to Table 1, the number of “vehicles per household”, the “electrification rate”, and the “car owners with private parking space” are considered in the simulation for both rural and urban regions. The charging points are statistically distributed across the network. Furthermore, the examined grids are considered residential areas. Thus, only the charging profiles for use case “home” are taken into account. Table 3 shows the Number of Households and BEVs within the examined rural and urban grids.

Table 3: Number of households and BEVs within the examined grids [13]

	RURAL GRID 1	RURAL GRID 2	RURAL GRID 3	URBAN GRID 1	URBAN GRID 2	URBAN GRID 3
NUMBER OF HOUSEHOLDS	13	99	118	41	104	111
NUMBER OF BEVS WITH HOME CHARGING PLACE	9	69	83	10	23	25

2 Results

The examinations of this paper show the influence of the different charging strategies on peak loads in different use cases and how many charging points are occupied at the same time. In addition, it was investigated how mobility behaviour differs in urban and rural areas and what influence this has on

charging performance. The power grid analyses show which effects arise in the low-voltage grid in urban and rural areas.

In the two weeks under consideration, the energy charged by the entire fleet of BEVs in Berlin sums up to 142,485 MWh (on average: 126 kWh per BEV); in rural Brandenburg, the sum is 8.60 % lower with 130,228 MWh (on average: 114 kWh per BEV). Table 4 provides information on how the total amount of charged energy is distributed among the four use cases in Berlin and Brandenburg. In Brandenburg, almost half of the total energy is charged at home, whereas in Berlin, it is less than 20 %. In Berlin, on the other hand, most of the energy is charged in a publicly accessible area.

Table 4: Energy charged by the entire electric vehicle fleet in the four use cases considered in Berlin and Brandenburg

	HOME	WORK	CHARGING HUB	PUBLIC
BERLIN	27,620.6 MWh	32,413.3 MWh	13,211.5 MWh	6,9240.1 MWh
IN %	19.38 %	22.75 %	9.27 %	48.59 %
BRANDENBURG	58,924.5 MWh	27,415.3 MWh	5,978.9 MWh	37,908.9 MWh
IN %	45.25 %	21.05 %	4.59 %	29.11 %

The load profile resulting from the three charging strategies in Berlin and Brandenburg are shown in Figure 4. The resulting load peaks depend strongly on the charging strategy. The highest load peaks result from applying the market-oriented charging strategy because the strategy treats all vehicles individually. Thus, each BEV takes advantage of the favourable charging times. In Berlin, the maximum charging power sums up to 1,537 MW for the strategy “greedy”, to 1,159 MW for the strategy “balanced”, and 8,678 MW for the strategy “market-oriented”. In Brandenburg, the maximum charging power for the strategy “greedy” and “balanced” are 18 to 32 % lower, with 1,266 MW and 793 MW, respectively. The strategy “market-oriented” in contrast results in a 15 % higher power peak of 10,013 MW.

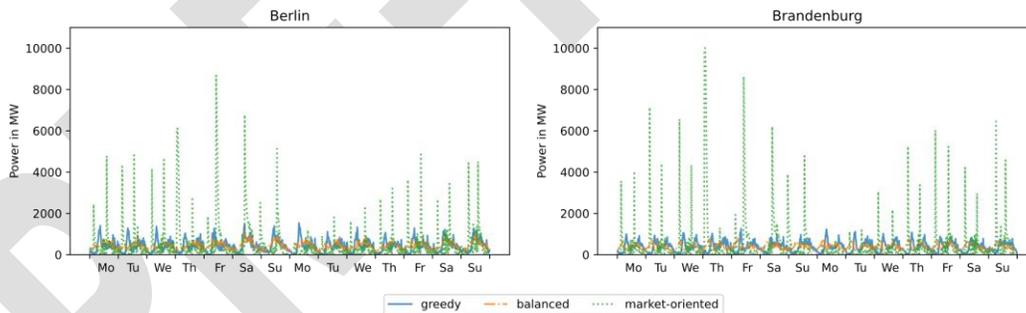


Figure 4: Total load profile for each charging strategies for Berlin and Brandenburg for 2 weeks

The examination of the individual use cases shows a different potential for load shifting and thus the applicability of charging strategies. Figure 5 shows the load profiles in the private space on the example of Berlin for two representative days. Long standing times in the private space offer a high potential for load shifting. By applying the strategy “greedy”, regular load peaks occur at the workplace, where many vehicles are connected in a short time window in the morning. At home, lower peaks occur because people do not get home as simultaneously as they go to work. The strategy “balanced” smooths the load profiles. At home, loads are shifted from evening to morning hours, and at work, the load is distributed

relatively evenly throughout the standing time. The market-oriented charging strategy results in high peak loads both at home and at work.

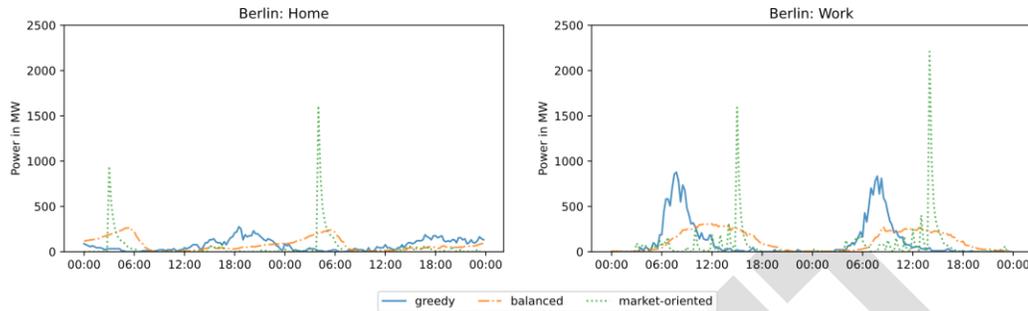


Figure 5: Load profile for each charging strategy in Berlin for 2 days in the private space

Figure 6 shows the load profiles in the publicly accessible space in Berlin for the same two days. The load profiles resulting from the charging strategies differ less than in the private space. Especially at charging hubs, the choice of charging strategy has little influence on the load profile. The need to recharge a relatively large amount of energy in a few minutes offers almost no potential to adjust the charging power. At the use case “public”, the potential for shifting loads is higher than at charging hubs. However, only minor differences can be observed between the strategies “greedy” and “balanced”. The balanced strategy manages to lower loads during the daytime by shifting loads into night hours. Load peaks result mainly from the market-oriented charging strategy. The same pattern can be observed in Brandenburg, except that higher loads occur at home and lower loads in the public space due to the different distribution of energy demand.

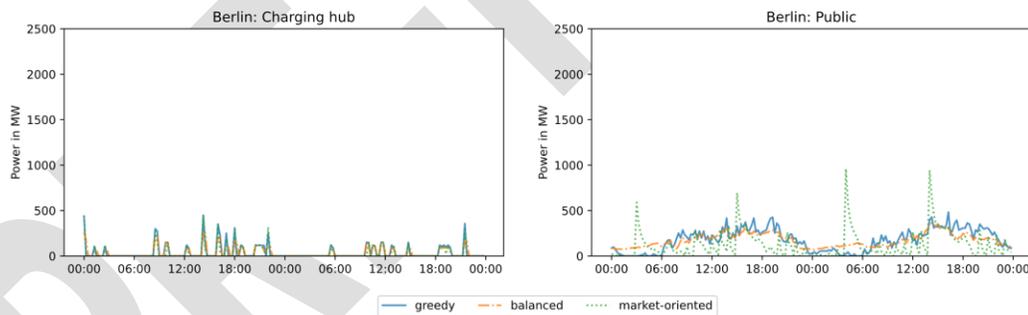


Figure 6: Load profile for each charging strategy in Berlin for 2 days in the publicly accessible space

Load peaks influence the voltage stability and the load on transformers and lines in the grids under consideration. Exemplary, the transformer load of rural grid 2 for different charging strategies over two representative days is depicted in Figure 7. The total transformer load comprises the regular household load and the load caused by different charging strategies. In contrast to the transformer load without BEVs, the transformer load increases in the “greedy” strategy, especially in the evening hours when many BEVs are plugged in and charging simultaneously (1). These charging events lead to additional transformer loading up to 20 %. The charging strategy “market-oriented” shows a significant increase in the load when the market price is low and cause severe high load peaks and an overload of the transformer (2). Furthermore, Figure 7 reveals that the “balanced” strategy can significantly reduce the

transformer load. Load peaks, which mainly occur in the evening, are decreased, and the charging is shifted to the night when the transformer load is at its lowest (3).

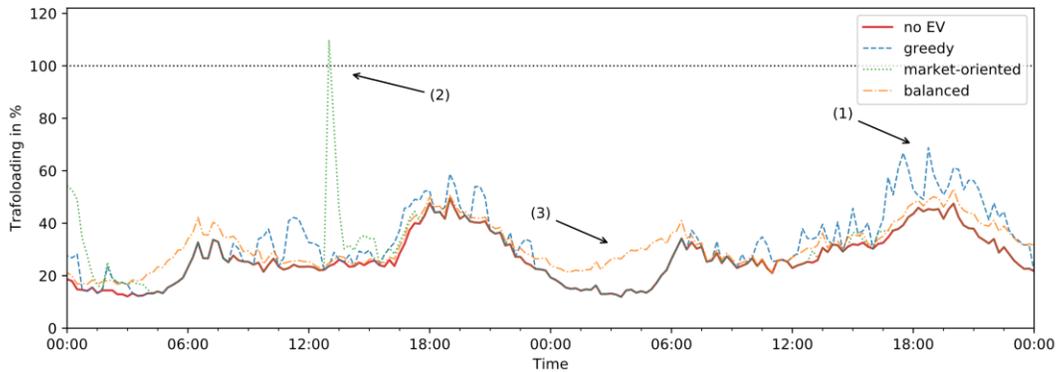


Figure 7: Transformer load caused by different charging strategies in LV-grid rural 2 at two representative days

Figure 8 depicts the impact of the three different charging strategies on rural and urban grids. The region types "rural" and "urban" each contain three grids' power flow calculation results. The results show that grid components such as transformers and lines in rural grids are exposed to much higher stress than urban grid components. This stress in rural grids is due to the higher number of BEVs with home charging point in 2040 (rural 54 %, urban 18 %). Furthermore, within the examined urban grids, transformers and lines can carry a higher power related to the household number within the grid. Longer line length and the resulting voltage drop over these lines additionally cause higher voltage deviation in the rural grids.

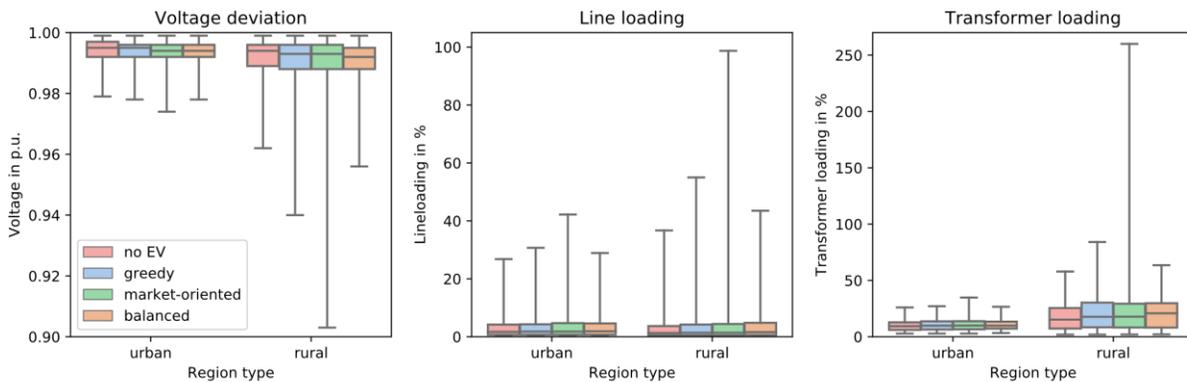


Figure 8: Voltage deviation, line loading and transformer loading caused by the charging strategies for rural and urban grids

Especially in rural grids, different charging strategies appear to have a significant impact on grid issues. Charging strategies such as "greedy" and "market-oriented" lead to higher loads on transformers and lines. Specifically, within the "market-oriented" scenario, transformer overloads up to more than 250 % occur several times, lines are loaded up to nearly 100 %, and voltage deviations almost reach the lower voltage band of 0,9 p.u. These crucial grid issues suggest that a pure market-oriented charging strategy

is not grid-serving. In contrast, the “balanced” strategy can reduce the charging peaks significantly and therefore relieve the grid to a large extent. The maxima of the voltage deviation and the transformer and line loadings are slightly higher than in the simulation without BEVs.

3 Discussion

This examination shows the impact of different charging strategies on power grids in urban metropolitan areas and predominantly rural areas using the German states Berlin and Brandenburg. In terms of charging strategies, both “greedy” and “market-oriented” represent extreme examples. The “greedy” strategy illustrates the load peaks that can occur with entirely uncontrolled charging. “Market-oriented”, on the other hand, shows the influence of a charging strategy that is purely oriented to the dynamic stock exchange electricity price. Since all vehicles individually use favourable times for charging without taking the other vehicles into account, high power peaks occur, which can cause overloads in the grid. The “balanced” strategy approach leads to an increase in the total charging power at the end of the idle times, which can be observed mainly in the use case home. Other approaches are conceivable to take advantage of the idle time and to avoid falling below the minimum charging power due to the efficiency. For example, charging could be done directly at the beginning until the desired SoC is reached, or the minimum possible charging power could also be randomly placed in the standing time, which would flatten the overall load curve further. Furthermore, the distribution among the use cases depends strongly on the defined probabilities.

In this paper, only 0.1 % of the overall predicted vehicle fleet in 2040 was simulated. For the whole number of BEVs in the examined regions of more than one million vehicles, it can be assumed that the load peaks are lower than in this analysis due to a random distribution. Thus, this study represents an extreme case with relatively high simultaneity factors. In addition, a vehicle ramp-up was assumed that does not consider changes in mobility behaviour. However, a change in the total number of vehicles or people's driving behaviour by 2040 would directly affect the charging profiles.

The study shows the effects of different charging strategies on charging profiles in individual use cases. There is little potential to shift loads at locations with short standing times, mainly in the publicly accessible space. Especially at charging hubs, there is hardly any flexibility because these fast charging events usually require a relatively large amount of energy to be recharged in only 15-30 minutes. At locations with long standing times on the other hand, the charging strategies have a substantial impact on the charging profiles, as can be seen for the “balanced” and “market-oriented” strategy. Especially at home and at work, the application of grid-serving charging strategies can lead to grid relief. Even a relatively simple charging strategy reduces grid issues significantly and could decrease or avoid expensive and time-consuming grid expansion in the future. In a 100 % renewable energy system, the load will have to be increasingly adapted to the generation to shift it in times of very high feed-in. The strategy “market-oriented” offers the potential to balance generation and BEV consumption. At the same time, a “market-oriented” strategy must not lead to grid overloads and should consider local grid restrictions.

4 Conclusion

The analysis of the two federal states has shown that there are apparent differences between urban and rural regions. Accordingly, different approaches are needed for the grid integration of electric vehicles. Because of a distinct mobility behaviour in both regions, the energy demand is distributed differently between private and public use cases. This different mobility behaviour results in individual potentials for load shifting. More energy is charged in private locations in rural areas, where long standing times offer a high potential to adjust the charging profile by applying charging strategies. In urban areas, on the other hand, people depend more on public charging locations, which offer less flexibility to apply charging strategies.

The examination shows that a simple balanced strategy can significantly reduce grid issues such as transformer and line overloads, especially in rural areas, where many charging processes simultaneously occur at home. Purely market-oriented charging, on the other hand, causes significant load peaks. That suggests that price signals must not be determined solely by a dynamic stock exchange electricity price but must also consider the local grid situation, such as voltage violation and overloading of grid components, the number of consumers, and their charging behaviour.

Acknowledgements

Jakob Gemassmer, Carolin Daam and Ricardo Reibsch gratefully thank the Reiner Lemoine Foundation for co-financing this research work.

References

- [1] Bruno Burger, *Energy-Charts*, Fraunhofer Institute for Solar Energy Systems ISE, Available at: <https://energy-charts.info/?l=en&c=DE>, accessed on 2021-02-23
- [2] Kraftfahrt-Bundesamt, *Elektromobilität in Deutschland auf der Überholspur*, Pressemitteilung Nr. 1/2021, Flensburg, 2021-01-06, Available at: https://www.kba.de/SharedDocs/Pressemitteilungen/DE/2021/pm_01_2021_E_Antrieb.pdf?__blob=publicationFile&v=6
- [3] National Platform Future of Mobility - Working group 5, *Demand-oriented and economical public charging infrastructure – plea for a dynamic NPM model (German report)*, Berlin, April 2020
- [4] C. Nobis, T. Kuhnimhof, *MID2017 – Mobilität in Deutschland 2017*, on behalf of Federal Ministry of Transport and Digital Infrastructure (BMVI), Bonn, Berlin 2018
- [5] Bund-Länder Demographie-Portal, *Entwicklung der Bevölkerungszahl nach Variante 2*, Available at: <https://www.demografie-portal.de/DE/Fakten/bevoelkerungszahl.html?nn=676784>
- [6] Kraftfahrt-Bundesamt, *Bestand an Kraftfahrzeugen und Kraftfahrzeuganhängern nach Bundesländern, Fahrzeugklassen und ausgewählten Merkmalen (FZ 27)*, Flensburg, 2021-03, Available at: https://www.kba.de/EN/Statistik_en/Fahrzeuge_en/fahrzeuge_node_en.html

- [7] Federal Ministry of Transport and Digital Infrastructure (BMVI), *Regionalstatistische Raumtypologie (RegioStaR)*, 2020-11, Available at: <https://www.bmvi.de/SharedDocs/DE/Artikel/G/regionalstatistische-raumtypologie.html>
- [8] K. Helfenbein, *Analyse des Einflusses netzdienlicher Ladestrategien auf Verteilnetze aufgrund der zunehmenden Netzintegration von Elektrofahrzeugen*, Hochschule für Technik und Wirtschaft Berlin - University of Applied Sciences, 2021-04
- [9] Auf der Maur et al., *Lade-Report: Entwicklung der öffentlich zugänglichen Ladeinfrastruktur für die Elektromobilität sowie Vergleich der Ladetarife in Deutschland*, 2020-02, Available at: https://www.prognos.com/sites/default/files/2021-01/20200207_prognos_lade-report_2020_01.pdf
- [10] Ashok Kaul et al., *Automobile Wertschöpfung 2030/2050*, 2019-12, Available at: https://www.bmwi.de/Redaktion/DE/Publikationen/Studien/automobile-wertschoepfung-2030-2050.pdf?__blob=publicationFile&v=16
- [11] G. Pasaoglu, D. Fiorello, L. Zani, A. Martino, A. Zubaryeva, C. Thiel, *Projections for Electric Vehicle Load Profiles in Europe Based on Travel Survey Data*, European Commission, DG JRC, Institute for Energy and Transport, 2013, Available at: <https://core.ac.uk/download/pdf/38626161.pdf>
- [12] Bundesnetzagentur, *SMARD - Electricity market data for Germany*, Available at: <https://www.smard.de/en>, accessed on 2021-05-01
- [13] S. Meinecke et al., *SimBench - Dokumentation, Dokumentationsversion DE-1.0.1, Elektrische Benchmarknetzmodelle*, 2019-08-26, Available at: https://simbench.de/wp-content/uploads/2019/08/simbench_documentation_de.pdf
- [14] J. Büchner, J. Katzfey, O. Flörcken, A. Moser, H. Schuster, S. Dierkes, T. van Leeuwen, L. Verheggen, M. Uslar, M. van Amelsvoort, *Moderne Verteilernetze für Deutschland (Verteilernetzstudie)*, E-Bridge - Kompetenz in Energie, Institut für Elektrische Anlagen und Energiewirtschaft (IAEW), OFFIS, 2014
- [15] S. A. A. Rizvi, A. Xin, A. Masood, S. Iqbal, M. U. Jan and H. Rehman, "Electric Vehicles and their Impacts on Integration into Power Grid: A Review", *2018 2nd IEEE Conference on Energy Internet and Energy System Integration (EI2)*, Beijing, China, 2018, pp. 1-6, doi: 10.1109/EI2.2018.8582069.
- [16] L. Thurner, A. Scheidler, F. Schäfer et al, *pandapower - an Open Source Python Tool for Convenient Modeling, Analysis and Optimization of Electric Power Systems*, in *IEEE Transactions on Power Systems*, vol. 33, no. 6, pp. 6510-6521, 2018-11
- [17] Tjaden, T.; Bergner, J.; Weniger, J.; Quaschnig, V.: *Repräsentative elektrische Lastprofile für Einfamilienhäuser in Deutschland auf 1-sekündiger Datenbasis*, Datensatz, Hochschule für Technik und Wirtschaft (HTW) Berlin, Lizenz: CC-BY-NC-4.0, downloaded on 2020-03-03
- [18] DIN EN 50160:2011-02, Merkmale der Spannung in öffentlichen Elektrizitätsversorgungsnetzen; Deutsche Fassung EN 50160:2010 + Cor. :2010

Authors



Jakob Gemassmer holds a master's degree in renewable energy systems from the Technical University of Berlin. He is a scientific researcher at the independent Reiner Lemoine Institut in Berlin. His focus is the grid integration of electric vehicles and their supply with renewable energies using energy system models and developing new charging strategies for electric vehicles. He is project manager to the project Netz_eLOG in which new control mechanisms for integrating large electric fleets are developed, depending on the local grid situation.



Carolin Daam is a scientific researcher at the independent Reiner Lemoine Institut in Berlin and holds a master's degree in renewable energy systems from the Technical University of Berlin. Her main research interest is battery electric mobility and its integration into the energy system. She is project manager of the projects EIMobileBerlin and "Electric Mobility Berlin 2025+" with a focus on the charging infrastructure needed in the future in Berlin and the surrounding area.



Ricardo Reibsch received his diploma degree in electrical engineering at the University of Technology in Berlin. He is writing his PhD thesis as a part of the RLS-Graduate School, which is funded by the Reiner Lemoine Foundation. As a scientific researcher, he is also part of the independent Reiner Lemoine Institute in Berlin. His research focuses on the role of decentralised battery systems in renewable and highly sector coupled electrical grids.

PRELIMINARY